


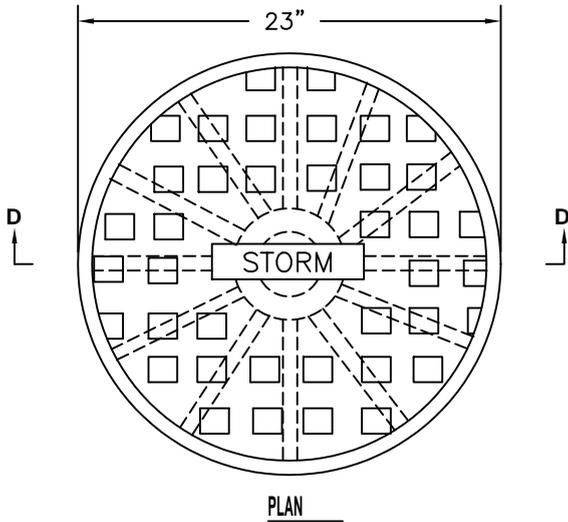




STANDARD DESIGN FRAME AND LIDS TYPE 1

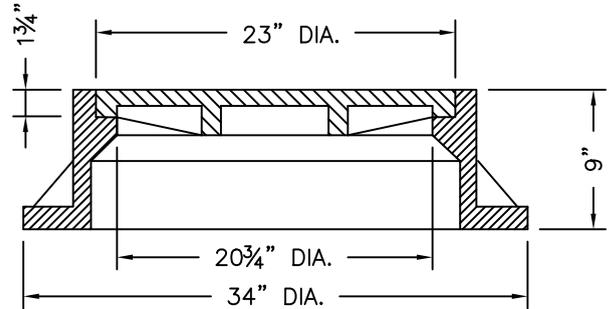


**CAST CLOSED LID
SECTION D-D**

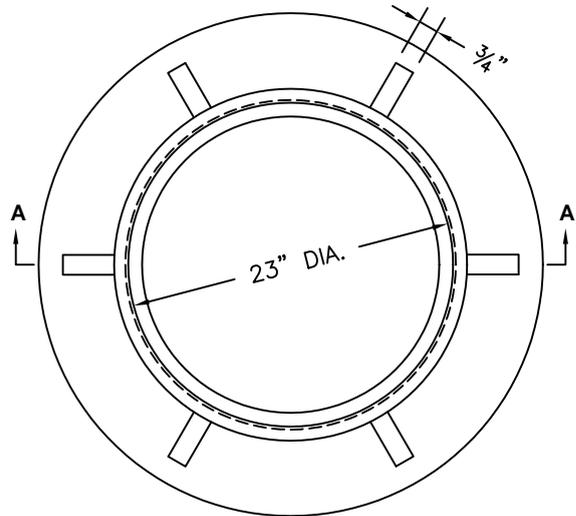

**SECTION A-A
CAST FRAME**

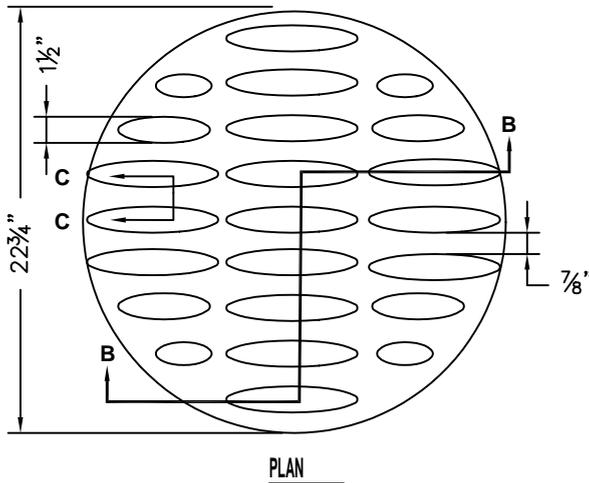

SECTION C-C

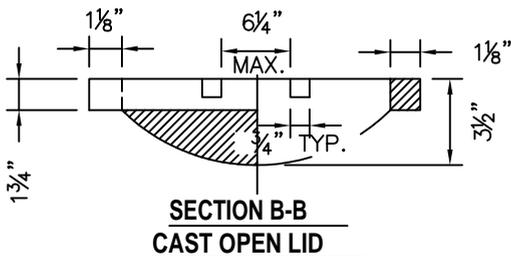

NOTES:

1. THE OPEN AND CLOSED LIDS MAY BE MADE OF EITHER GRAY IRON OR DUCTILE IRON.
2. CLOSED LID SHALL HAVE CONCEALED PICKHOLE.
3. CLOSED LID SHALL BE GASKETED IF INSTALLATION IS FOR A SEPARATE SANITARY SEWER.
4. THE LID SHALL BE CAST 'STORM' IF INSTALLATION IS FOR A SEPARATE STORM SEWER.
5. THE LID SHALL BE CAST 'SANITARY' IF INSTALLATION IS FOR A SEPARATE SANITARY SEWER OR COMBINATION SEWERS.
6. THE LID SHALL BE CAST 'COMBINED' IF INSTALLATION IS FOR A COMBINED SEWER.

CITY OF DECATUR, ILLINOIS
DEPARTMENT OF ENGINEERING
& INFRASTRUCTURE

ADOPTED JANUARY 1, 2003

DIRECTOR OF ENGINEERING & INFRASTRUCTURE

ISSUED: 7-3-78	
REVISIONS	
BY	DATE
K.G.Q.	4/8/00
JMM	5/1/02

STANDARD# 2020