



# STANDARD DESIGN WATER SERVICE INSTALLATION TYPICAL DOMESTIC WATER SERVICE

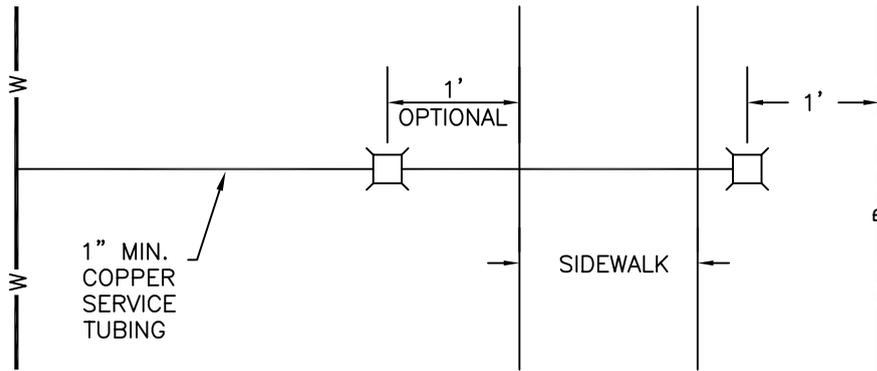

## PLAN

N.T.S.

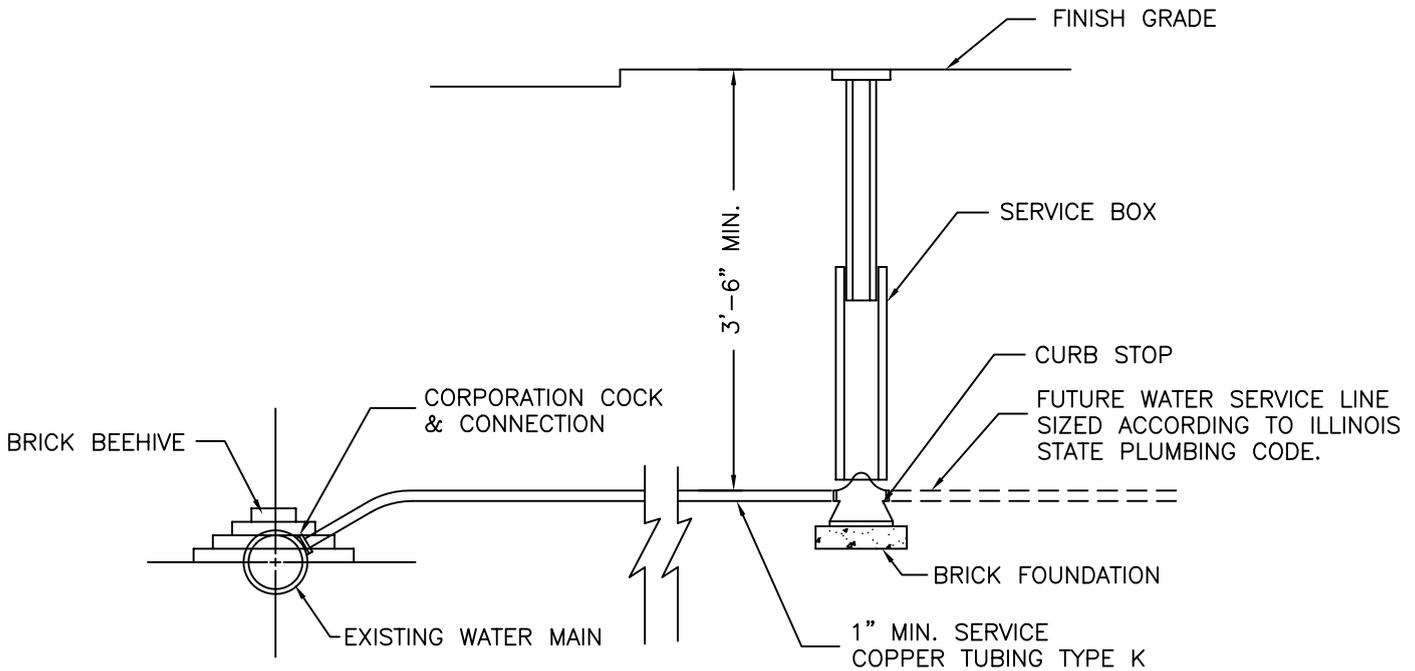

## SECTION A-A

N.T.S.

### NOTES:

1. CORPORATION COCK SHALL BE MUELLER #H-15000 OR APPROVED EQUAL.
2. CURB STOP SHALL BE MUELLER #H-15154 OR APPROVED EQUAL.
3. SERVICE BOX SHALL BE #H-10300 OR APPROVED EQUAL.
4. WATER SERVICE SHALL CONFORM TO CITY CODE CHAPTER 64.

CITY OF DECATUR, ILLINOIS  
DEPARTMENT OF PUBLIC WORKS  
ENGINEERING DIVISION

ADOPTED JANUARY 1, 2003

DIRECTOR OF PUBLIC WORKS

ISSUED: 7-3-78

REVISIONS	
BY	DATE
SHOE	1/2/90
RNB	1/1/02

STANDARD# 4040

K:\CVCEngineer\eng-dca\AUTOCAD\STANDARD\STANDARD.dwg, 30 Apr 2003 - 11:04am