



STANDARD DESIGN CONCRETE BLOCKING WATERMAIN - 6" TO 10"

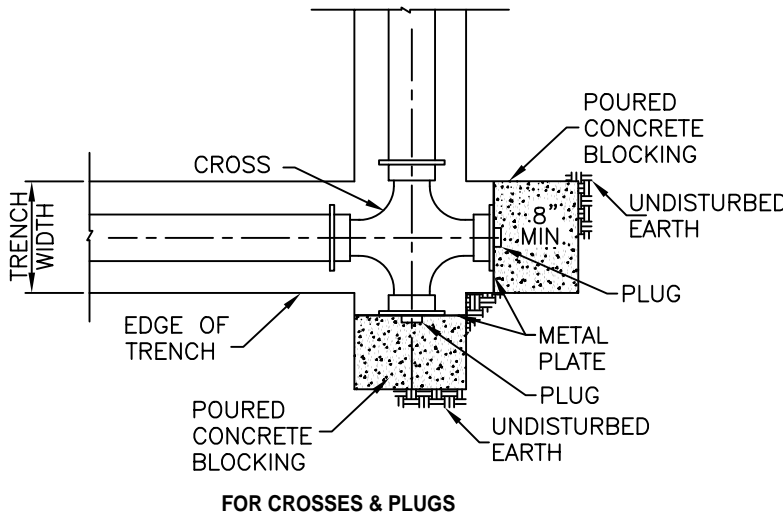


FOR CROSSES & PLUGS

PLAN

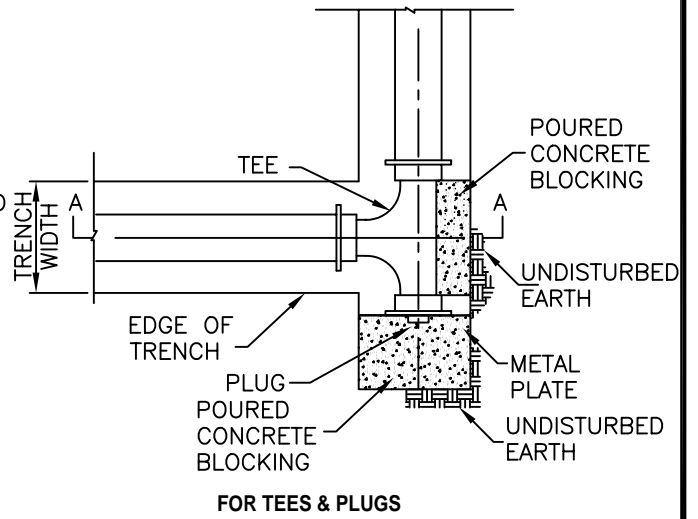


FOR TEES & PLUGS

PLAN

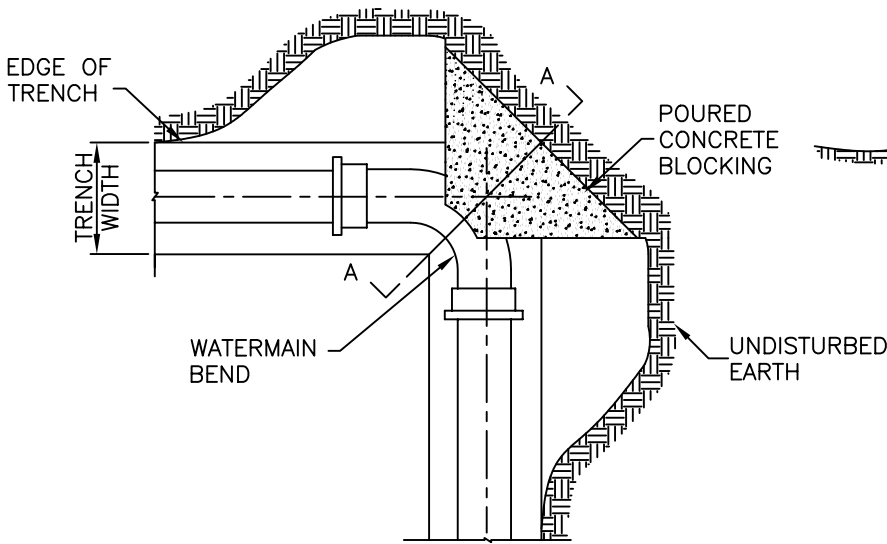

FOR WATERMAIN BENDS

PLAN

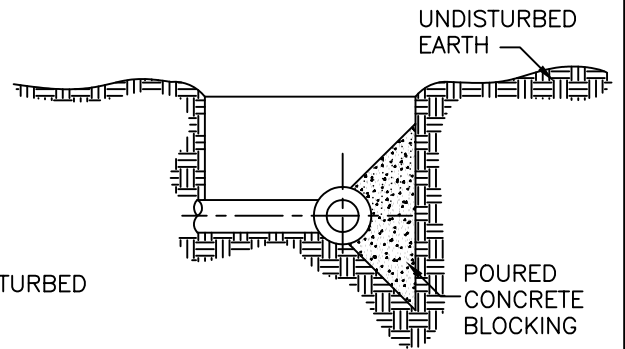

SECTION A-A

NOTES:

1. CONCRETE BLOCKING SHALL BE SIMILAR FOR ALL BENDS.
2. PRECAST CONCRETE BLOCKING MAY BE USED WITH APPROVAL OF ENGINEER.
3. WRAP CONNECTION ENDS IN PLASTIC SHEETING, NOT LESS THAN 4mil THICKNESS, PRIOR TO POURING CONCRETE BLOCKING.

STANDARD #4020

CITY OF DECATUR, ILLINOIS
DEPARTMENT OF ENGINEERING
& INFRASTRUCTURE

ADOPTED JANUARY 1, 2003

[Signature]
DIRECTOR OF ENGINEERING & INFRASTRUCTURE

ISSUED: 1/1/03	
REVISIONS	
BY	DATE
R.W.D.	3/2/97
RNB	01/01/2003

K:\CVCEngineer_eng-data\AUTOCAD\STANDARD\Standards 2003\Star4020.dwg\Wed, 30 Apr 2003 - 11:02am