



STANDARD DESIGN WATER SERVICE DISCONNECT TYPICAL DOMESTIC WATER SERVICE

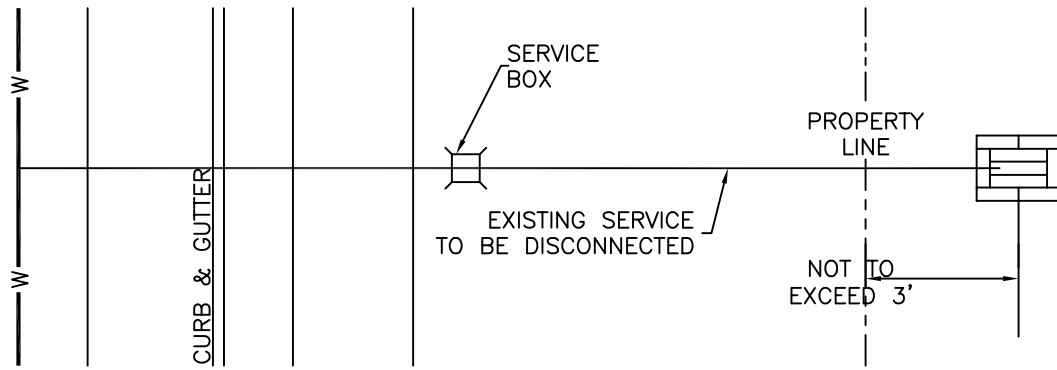

PLAN

N.T.S.

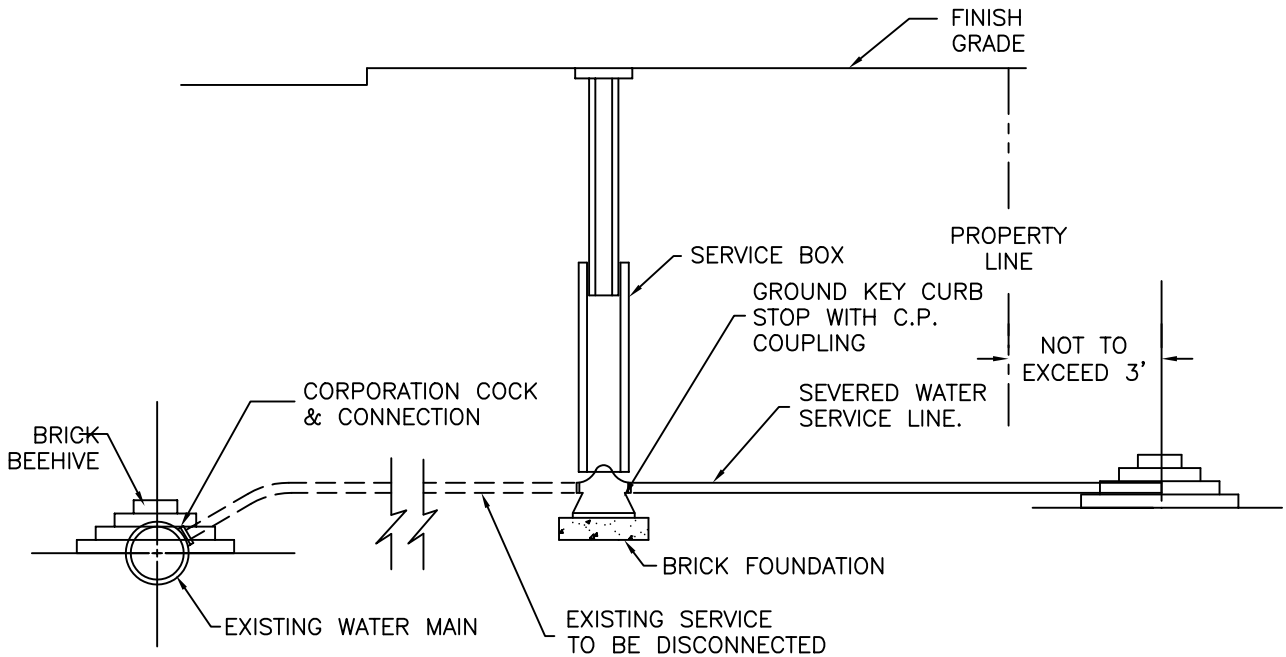

PROFILE

N.T.S.

NOTES:

1. BRICK BEE-HIVE SHALL BE TWO ROWS ABOVE SEVERED SERVICE AND TWO ROWS BELOW SERVICE AND SHALL COVER 6" OF LINE.
2. THE EXISTING WATER SERVICE LINE SHALL BE SEVERED BY A METHOD WHICH WILL NOT DAMAGE THE REMAINDER OF THE WATER SERVICE. ANY DAMAGE WILL BE REPAIRED BY THE CONTRACTOR AT CONTRACTOR'S OWN COST.
3. WATER SERVICE DISCONNECT AT WATER MAIN SHALL HAVE COUPON INSTALLED AT CORP. COCK CONNECTION IN PLACE OF PREVIOUS SERVICE LINE.

CITY OF DECATUR, ILLINOIS
DEPARTMENT OF PUBLIC WORKS
ENGINEERING DIVISION

ADOPTED JANUARY 1, 2003

[Signature]
DIRECTOR OF PUBLIC WORKS

ISSUED: 1-1-2003	
REVISIONS	
BY	DATE
KSG	1/1/2003

STANDARD# 4070
SHEET #1 OF 2

K:\CVC\Engineer\eng-data\AUTOCAD\STANDARD\Standards 2003\Std4070 sheet 1 of 2.dwg Wed, 30 Apr 2003 11:05am